

**ATTAR TEST REPORT NUMBER: 14/8242.1**

The results of the tests, calibrations and/or measurements included in this document are traceable to Australian/national standards.  
Accredited for compliance with ISO/IEC 17025.  
Accreditation Number: 2735

12 September 2014

**Total Pages: 2****OIL-WET INCLINING PLATFORM SLIP RESISTANCE**

Job No: M14/8242

<b>Prepared for:</b>	Mirotone Pty Ltd 21 Marigold Street REVESBY NSW 2212	
<b>Attention:</b>	Ian McGregor	
<b>Test Site:</b>	ATTAR, Unit 1, 64 Bridge Road, Keysborough.	
<b>Test Date:</b>	10 September 2014	
<b>Manufacturer:</b>	Unknown	
<b>Test Specimen, Size &amp; Quantity:</b>	One coat FASTASEAL 3030 Clear Sealer. One coat DURAPOL 1045 SUPER GLOSS. One coat DURAPOL 1045 SUPER GLOSS containing Polycure 3920 High Grip applied to timber board. 1000x500 mm, 1 off supplied, Refer to Figure 1.	
<b>Sampling &amp; Direction of Testing:</b>	Sampling conducted by client. Test conducted parallel with grain of timber.	
<b>Test Personnel:</b>	Marcus Braché & Daniel King	
<b>Preparation:</b>	Washed with pH neutral detergent, rinsed with water, then dried.	
<b>Joint Width:</b>	N/A	
<b>Air Temperature:</b>	22°C	
<b>Test Standard:</b>	AS 4586 - 2013 Slip resistance classification of new pedestrian surface materials – Appendix D.	
<b>Surface Structure :</b>	Structured	
<b>Test Shoes:</b>	Lupos Picasso	
<b>Classification Criteria:</b> (TABLE 5 in AS 4586 - 2013)	<b>Classification</b>	<b>Angle, degrees</b>
	No Classification	<6
	R9	≥6<10
	R10	≥10<19
	R11	≥19<27
	R12	≥27<35
	R13	≥35
<b>Displacement Space:</b>	Not Measured	
<b>Displacement Space Assessment Group:</b>	N/A	
<b>Corrected Mean Overall Acceptance Angle (rounded down to the nearest degree):</b>	<b>23°</b>	
<b>Classification:</b>	<b>R11</b>	


These results apply only to the specimens tested and it is recommended that before selection of flooring or paving materials the effect of service conditions, including maintenance procedures and wear on their slip-resistance be checked.

**NOTE:** Any specimens supplied will be disposed of in two (2) months time, unless otherwise instructed.

**ATTAR**

Marcus Braché  
Senior Engineering Technician  
Approved Signatory

This report may not be reproduced except in its entirety.

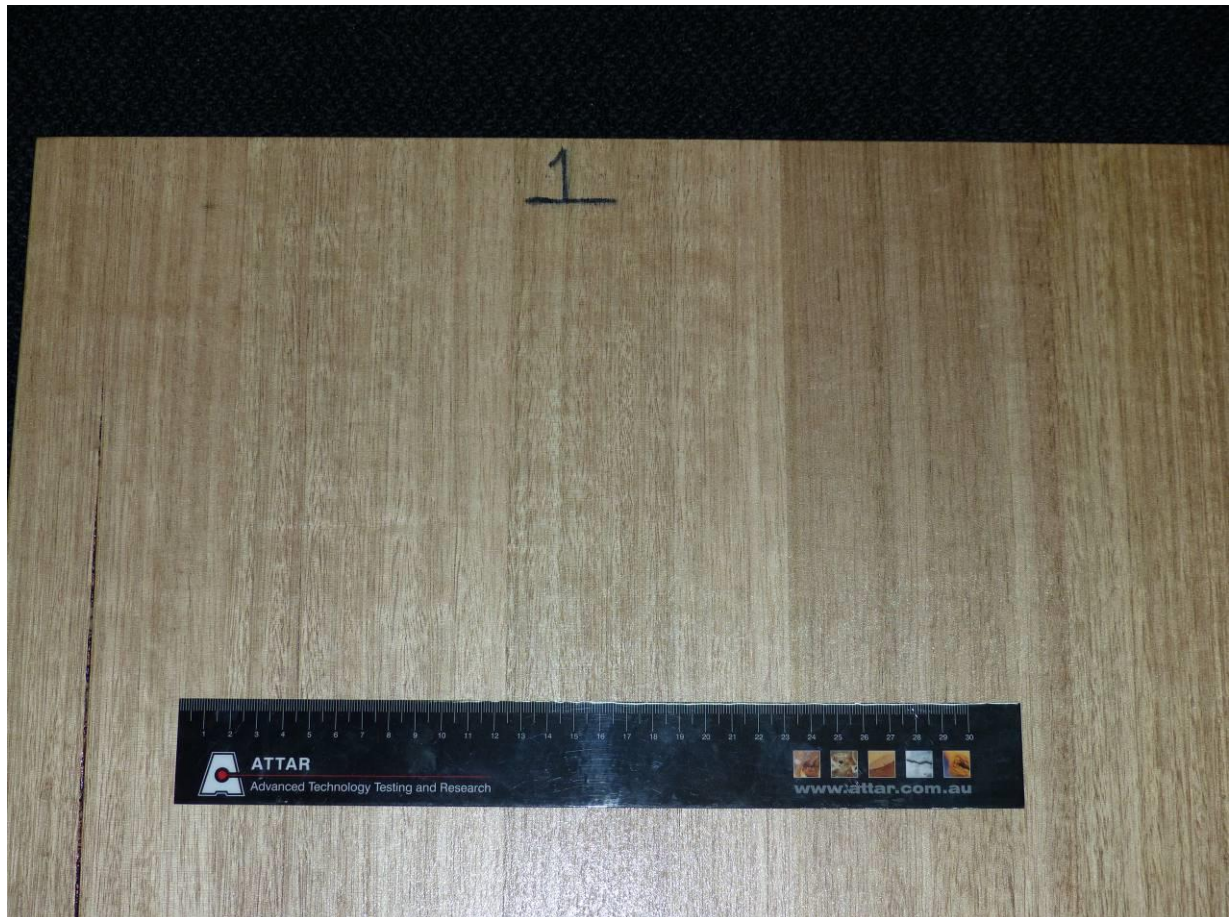

**Figure 1:** One coat FASTASEAL 3030 Clear Sealer. One coat DURAPOL 1045 SUPER GLOSS. One coat DURAPOL 1045 SUPER GLOSS containing Polycure 3920 High Grip applied to timber board.